

Industrial effluent treatment with immersed MBRs: treatability and cost

Hazim Qiblawey and Simon Judd

ABSTRACT

A comprehensive OPEX analysis for both municipal and industrial wastewaters has been conducted encompassing energy, critical component (membrane) replacement, chemicals consumption, waste disposal and labour. The analysis was preceded by a review of recent data on industrial effluent treatability with reference to published chemical oxygen demand (COD) removal data for four effluent types: food and beverage, textile, petroleum and landfill leachate. Outcomes revealed labour costs to be the most significant of those considered, contributing 50% of the OPEX for a 10,000 m³/day capacity municipal wastewater treatment works. An analysis of the OPEX sensitivity to 12 individual parameters (labour cost, flux, electrical energy cost, membrane life, feed COD, membrane cost, membrane air-scour rate, chemicals cost, waste disposal cost, mixed liquor suspended solids (MLSS) concentration, recirculation ratio, and transmembrane pressure) revealed OPEX to be most sensitive to labour effort and/or costs for all scenarios considered other than a large (100,000 m³/day capacity) works, for which flux and electrical energy costs were found to be slightly more influential. It was concluded that for small- to medium-sized plants cost savings are best made through improving the robustness of plants to limit manual intervention necessitated by unforeseen events, such as electrical/mechanical failure, foaming or sludging.

Key words | industrial effluent, membrane bioreactor, operating cost, sensitivity, treatability

Hazim Qiblawey

Department of Chemical Engineering,
Qatar University,
Doha,
Qatar

Simon Judd (corresponding author)

Cranfield Water Science Institute,
Cranfield University,
Cranfield,
Bedford,
UK
E-mail: s.j.judd@cranfield.ac.uk

INTRODUCTION

Membrane bioreactors (MBRs) offer an alternative to treatment by the conventional activated sludge (CAS) process when a relatively high-quality effluent is required, specifically with reference to the colloidal, phosphorus and/or microbial content (Judd 2011). In such cases, the CAS process must be fitted with tertiary treatment (or 'polishing') to attain a comparable water quality. Most comparative cost analyses from the past decade have concluded that, for moderate- to large-scale installations, the capital cost (CAPEX) of large-scale MBRs tend to be slightly lower than the CAS + polishing alternative (Brepols *et al.* 2010; Young *et al.* 2013; Iglesias *et al.* 2017) particularly when (a) available space is at a premium and/or costly, or (b) polishing employs membrane filtration (Iglesias *et al.* 2017). However, it is also the case that operating expenditure (OPEX) is generally higher due to the requirement for scouring of the immersed membrane by coarse bubble aeration.

Thus far, quantification of the operational parameters impacting on OPEX have tended to focus on energy

consumption generally (Díaz *et al.* 2017; Krzeminski *et al.* 2017; Tang *et al.* 2018), and the membrane air-scour energy of an iMBR in particular (González *et al.* 2018; Miyoshi *et al.* 2018; Wang *et al.* 2018). Recent reports suggest specific aeration demand (SAD) values of 0.13–0.3 Nm³·h⁻¹ per m² membrane area (Miyoshi *et al.* 2018; Wang *et al.* 2018), or as low as 6–8 Nm³ per m³ permeate (Díaz *et al.* 2017) depending on the membrane configuration. This has led to reported mean energy consumptions in the region of 0.35–0.65 kWh per m³ permeate for large municipal iMBR installations commissioned after 2014 in China (Xiao *et al.* 2019).

There have thus been significant economies made over the past 10 years in energy consumption. Coupled with this has been steadily decreasing membrane replacement costs, due to decreasing purchase prices coupled with demonstrated extended membrane life (Côté *et al.* 2012). It is thus prudent to consider the sensitivity of OPEX to all contributing factors, namely energy and chemicals consumption, membrane replacement, plant servicing (i.e. labour), and

waste disposal. Since OPEX is highly dependent on the feedwater quality, and specifically the energy demanded by the aerobic degradation of the feedwater organic and amino/ammoniacal substances, the feedwater characteristics must also be taken into consideration.

In the current paper the sensitivity of the overall OPEX to 12 individual operating parameters is computed for four scenarios based on municipal and industrial wastewater treatment by an iMBR. Governing empirical equations for individual OPEX contributions are taken from or informed by literature information/data. The OPEX analysis is preceded by an appraisal of industrial effluent treatability, based on published chemical oxygen demand (COD) removal data for four generic effluent types, since this impacts significantly on the microbiological (or 'process') energy demand.

METHODS

Data sources

Wastewater quality and treatability

A single medium-strength municipal wastewater quality was used as a benchmark, informed by various reference texts such as Tchobanoglous *et al.* (2003). Industrial wastewater quality and treatability data was obtained from the reference of text of Judd (2014) for full-scale case MBR studies, along with the review articles by Lin *et al.* (2012), Larrea *et al.* (2014), Hashisho & El-Fadel (2016) for landfill leachate and Jegatheesan *et al.* (2016) for textile wastewaters. These data were embellished by more recent data extracted from peer-reviewed literature and conference publications published predominantly from 2010 onwards. COD removal data trends were formed from at least 10 data points for the four different industrial effluent types (see supplementary data, available with the online version of this paper).

Operation and maintenance (O&M)

O&M data, and specifically those relating to flux, membrane aeration and chemical cleaning frequency, were taken from Judd (2011, 2014). These data were supplemented with available data from the operation of full-scale industrial effluent treatment installations.

Costs

Energy consumption is based primarily on air and liquid pumping, with air pumping demanded for the process biology

tank and, in the case of immersed membranes, membrane scouring. Liquid pumping relates to permeate extraction and sludge transfer between tanks. To maintain consistency, the analysis was restricted to the Modified Ludzack-Ettinger (MLE) configuration for two-stage nitrification–denitrification. The specific aeration demand for the biochemical process (SAD_{bio}) was determined based on standard bio-stoichiometric relationships, as outlined in reference texts such as Tchobanoglous *et al.* (2003) and Judd (2011). The small amount of electrical energy for monitoring and control was ignored in this analysis.

A mean membrane cost was assumed based on information from suppliers and end users. Chemicals were assumed to be used solely for membrane cleaning. Published analyses, partly based on data from full-scale operating plant, suggest this cost contributes 7–15% to the total OPEX (Brepols *et al.* 2010; Young *et al.* 2013). In the current study, the permeate-normalised chemicals consumption cost, L_C , was based on fixed-interval maintenance cleaning using sequential hypochlorite and citric acid cleans of fixed duration. Sodium hypochlorite and citric acid costs of $\$800 \cdot t^{-1}$ and $\$500 \cdot t^{-1}$ were assumed for 15% and 50% stock solutions, respectively. These were assumed to be dosed at 0.04 and 0.2%, respectively, for 30 min each at twice the forward flux (J) during a twice-weekly maintenance clean.

Sludge disposal costs are very location specific. A past comparison of landfill disposal costs revealed this to be less than $\$100 \text{ teDS}^{-1}$ (dry solids) in the USA compared with more than $\$250 \text{ teDS}^{-1}$ in Europe, and a more recent analysis as being €20–100 per te sludge (Bertanza *et al.* 2015). The contribution of waste disposal to overall OPEX has been calculated as being 8–16% (Brepols *et al.* 2010; Verrecht *et al.* 2010). In the current analysis, a mean disposal cost (L'_{DS}) of $\$100 \text{ teDS}^{-1}$ has been assumed. Since the DS generated is directly related to the COD by the observed sludge yield (Y_{obs}), waste disposal costs are roughly proportional to the feedwater COD provided Y_{obs} is constant.

Information on staffing levels was taken from three sources: (a) Ovivo MBR plant installations (Ovivo 2018), providing six data; (b) the Missoula wastewater treatment staffing assessment (Cormier & Murphy 2013), eight data; and (c) the Northeast guide for estimating staffing at publicly and privately owned wastewater treatment plants (Poltak 2008). The Poltak (2008) report advocates a method in which full-time equivalent (FTE) hours are assigned to specific pieces of equipment, infrastructure or tasks. For comparability with the two other data sets, only the operator

effort was considered from this analysis, encompassing ancillary costs. The labour cost at a given plant capacity is then given by the FTE multiplied by the gross salary (paid salary + employer's tax + overhead). The complete data sets of (a)–(c) were used to generate the algorithm for normalised FTE (FTE per unit flow Q) vs. Q .

Labour cost was assumed to be the only cost component to change with flow, although it is recognised that at very low flows sub-optimal operation prevails due to equipment oversizing. Such impacts on OPEX were assumed to be insignificant at the lowest flow of $2,000 \text{ m}^3 \cdot \text{d}^{-1}$ considered in the current study.

Base parameter values and algorithms

Selected base parameter values sourced from literature are given in Table 1. The governing equations for determining main specific energy consumption (SEC, denoted E) and other cost contributors (Table 2) dictate SAD_{bio} to be a function of (i) the concentration of COD and total Kjeldahl nitrogen (TKN) removed (yielding the oxygen demand D_{O_2}), and (ii) the physical relationships linking the energy required to pump the air (E'_A) with the efficiency of oxygen transfer into the sludge. The latter relates to the alpha factor (α), for which many authors have presented empirical correlations with sludge concentration.

Scenarios

The analysis considers four scenarios (Table 3) encompassing different flows and feedwater COD and TKN loads according to the plant size and feedwater type (municipal or industrial). Results are presented as (a) contributions from the five main cost factors (L in \$ per m^{-3} permeate) of total energy ($L_{E,tot}$), membrane replacement (L_{MR}), chemical consumption (L_C), Labour (L_L), and waste (L_W), and (b) % cost sensitivity. The sensitivity of overall OPEX (L_O) to a 20% change in a specific parameter was computed for 12 parameters: feed COD and MLSS (X) concentration, net flux (J), transmembrane pressure (TMP), specific aeration demand for membrane scouring (SAD_m), recirculation ratio (R), electrical energy cost (L_E), membrane cost (L_M), membrane life (t), chemicals cost (L_C), labour cost (L_L) and waste disposal cost (L_W). A 20% increase was computed for all parameters other than cost and membrane life, for which a 20% decrease (i.e. a 20% improvement) was computed for comparability.

RESULTS AND DISCUSSION

Data processing

α -factor correlations

α -factor trends with sludge concentration have tended to take the form of either a linear (Henkel *et al.* 2011; Kim *et al.* 2019) or exponential (Rosenberger 2003; Germain *et al.* 2007; Xu *et al.* 2017) decline with the MLSS (mixed liquor suspended solids, X) or MLVSS (mixed liquor volatile suspended solids, X') concentration. As has been widely acknowledged (Henkel *et al.* 2011), there is little consistency between the various correlations generated between α and X (Figure 1). Within the range of MLSS concentration appropriate to the MBR process tank (6–12 g/L), the averaged α -factor trend for $X > 6 \text{ g/L}$ (where $\alpha \sim 1$ at $X < 6$) is:

$$\alpha = 1.72e^{-0.094X} \quad (1)$$

Feedwater quality and purification

Trends in COD removal with concentration for the four industrial effluent types suggest that for all types other than landfill leachate, removal is in the 90–99% range above feed concentrations of 1,000 mg/L (Figure 2). The % removal trend sharply declines below 1,000 mg/L feed COD for the textile and petroleum effluent data. Although all three data sets (i.e. food and beverage, petroleum and textile effluents) are highly scattered, a roughly logarithmic function can be used to define % removal up to a concentrations of $\sim 4,000 \text{ mg/L}$ COD. Beyond this threshold COD removal appears to be in the 97–99% range for these effluents. At feed COD concentrations of 200–6,000 mg/L the mean COD removals for food and beverage, textile and petroleum effluents are $97.2 \pm 2.0\%$, $92.6 \pm 5.0\%$ and $90.7 \pm 5.9\%$, respectively (Figure 3(a)).

In the case of landfill leachate, mean removals are much lower and very highly scattered at $82.0\% \pm 10.2\%$ (Figure 3(a)), with no evident trend with feed COD concentration (Figure 2). This results in considerably higher COD levels in the permeate (Figure 3(b)) – more than 20 times that of food and beverage effluent over the same of COD feed concentration range (200–14,000 mg/L). It is well known (Hashisho & El-Fadel, 2016; Alvarez-Vazquez *et al.* 2004) that landfill leachate treatability varies with its age, with old leachates being generally more biorefractory than younger ones. However, a consideration of COD removal

Table 1 | iMBR operational process parameter base values

Parameter	Symbol	Value(s): Base, range
Aerator depth, process, membrane tanks, m	h	5, 3.5
Air density, $\text{g} \cdot \text{m}^{-3}$	ρ_A	1.23
Alpha factor	α	Section 4.1
Biomass COD, TKN content, $\text{kg} \cdot \text{kgSS}^{-1}$	$\lambda_{\text{COD}}, \lambda_{\text{TKN}}$	1.1, 0.095
Change in COD, TKN, NO_3^- concs., $\text{g} \cdot \text{m}^{-3}$	$\Delta S_{\text{COD}}, \Delta S_{\text{TKN}}, \Delta S_{\text{Nitrate}}$	Section 4.2
Chemicals consumption costs, $\text{\$} \cdot \text{m}^{-3}$ permeate	L_C	0.031 ^a
Conversion (permeate/feed flow)	Θ_{MBR}	96%
Electricity supply cost, $\text{\$} \cdot \text{kWh}^{-1}$	L_E	0.1
Labour costs, $\text{\$} \cdot \text{m}^{-3}$ permeate	L_L	Section 4.3
Mass consumption of oxygen, $\text{g} \cdot \text{m}^{-3}$	D_{O_2}	Calculated (Table 2)
Mass transfer correction factors for oxygenation, -	β, γ	0.95, 0.89
Membrane cost, $\text{\$} \cdot \text{m}^{-2}$ membrane area	L_M	30
Membrane life, h	t	52,560, 70,080
Membrane-biological process tank recycle ratio, -	R	4
MLSS concentration, process tanks $\text{kg} \cdot \text{m}^{-3}$	X	8
Observed sludge yield, $\text{kgSS} \cdot \text{kgCOD}^{-1}$	Y_{obs}	0.35
Oxygen content of air, %	C'_A	21%
Oxygen transfer efficiency per unit depth, m^{-1}	OTE	0.045
Permeate flow rate (plant capacity), $\text{m}^3 \cdot \text{d}^{-1}$	Q_P	2,000, 10,000, 100,000
Permeate net flux, industrial, municipal, $\text{L} \cdot \text{m}^{-2} \cdot \text{h}^{-1}$	J	15, 20
SAD, biological aeration, $\text{Nm}^3 \cdot \text{m}^{-3}$ permeate	SAD_{bio}	Calculated (Table 2)
SAD, membrane scouring, $\text{Nm}^3 \cdot \text{m}^{-2} \cdot \text{h}^{-1}$	SAD_m^{b}	0.30
SEC, biological aeration, $\text{kWh} \cdot \text{Nm}^{-3}$ air	$E'_{A,\text{bio}}$	Calculated (Table 2)
SEC, biological aeration, $\text{kWh} \cdot \text{m}^{-3}$ permeate	$E_{A,\text{bio}}$	Calculated (Table 2)
SEC, membrane aeration, $\text{kWh} \cdot \text{Nm}^{-3}$ air	$E'_{A,m}^{\text{c}}$	Calculated (Table 2)
SEC, membrane aeration, $\text{kWh} \cdot \text{m}^{-3}$ permeate	$E_{A,m}^{\text{d}}$	Calculated (Table 2)
SEC, permeate pumping, $\text{kWh} \cdot \text{m}^{-3}$ permeate	$E_{L,p}^{\text{e}}$	Calculated (Table 2)
SEC, sludge pumping, $\text{kWh} \cdot \text{m}^{-3}$	$E_{L,s}^{\text{f}}$	0.016.R
Transmembrane pressure, bar	TMP	0.3
Total pumping electrical energy efficiency, -	ϵ_{tot}	60% (air), 70% (sludge)
Waste sludge disposal costs, $\text{\$} \cdot \text{teDS}^{-1}$	L'_{DS}	100

^aBased on the stated fixed interval (maintenance) cleaning schedule.

^bSAD Specific aeration demand (air flow rate/membrane area for air scour), mean value from Judd (2011); SEC specific energy consumption, kW per m^3 permeate.

^cBlower power/air flow rate.

^dBlower power/permeate flow rate.

^ePump power/permeate flow rate.

^fPump power/sludge flow rate. Underscored parameter values dependent on scenario.

with BOD/COD ratio, based on available landfill leachate data (Figure 4), again indicates very significant data scatter with removals ranging from 68% to 96% at BOD/COD ratios below 0.2.

For the purposes of the OPEX calculations, the COD removal was based on a food effluent source for the industrial effluent scenarios. These effluents are generally low in

TKN (Lin *et al.* 2012; Judd 2014). A COD concentration of $2,000 \text{ mg} \cdot \text{L}^{-1}$ was assumed based on a pre-clarified effluent at high COD concentrations, with clarification normally achieved using dissolved air flotation, and a TKN:COD mass ratio of 0.01. At this concentration, COD removal is around 97–98% (Figure 2). For the municipal effluent, the feed COD concentration was taken as $500 \text{ mg} \cdot \text{L}^{-1}$ and

Table 2 | OPEX-related equations (adapted from Judd 2017)

Parameter	Symbol	Equation
Membrane		
SEC, total, kWh · m ⁻³	E_m	$E'_{A,m} SAD_m / J + E_{L,s} R + E_{L,m}$
SEC, permeation ^a , kWh · m ⁻³	$E_{L,m}$	$TMP / (36 \epsilon_{tot})$
Process biology (assuming MLE process denitrification)		
Oxygen demand, kg · m ⁻³	D_{O_2}	$\Delta S_{COD} (1 - \lambda_{COD} Y_{obs} - 1.71 \lambda_{TKN} Y_{obs}) + 1.71 \Delta S_{TKN} - 2.86 \Delta S_{Nitrate}$
SAD, Nm ³ · m ⁻² · h ⁻¹	SAD_{bio}	$D_{O_2} / (\rho_A C'_A OTE y \alpha \beta \gamma) \cdot Q_F = Q_{A,bio} / Q_F$
SEC, aeration ^b , kWh · Nm ³	E'_A	$k ((0.0987h + 1)^{0.283} - 1) / \epsilon_{tot}$ where $k = 0.103 \text{ kWh} \cdot \text{Nm}^{-3}$
SEC, permeation, kWh · m ⁻³	$E_{A,bio}$	$E'_{A,bio} SAD_{bio}$
Waste sludge disposal		
Cost, waste disposal, \$.m ⁻³ permeate	L_W	$Y_{obs} \text{ COD } L'_{DS} / 10^6$
OPEX		
Cost m ⁻³ permeate, \$.m ⁻³	L_O	$L_E (E_m + E_{A,bio}) + L_M / (J t) + L_C + L_W + L_L$

^aJ takes units of m³ per m² per h.

^bEnergy demand per unit volume (Nm³) of air for membrane air scour ($E'_{A,m}$) or process biology aeration ($E'_{A,bio}$). All symbols as defined in Table 1.

Table 3 | Scenarios and key parameter values

Scenario	Q m ³ /d	COD mg/L	J LMH	t h
1 Medium municipal works	10,000	500	20	70,080
2 Large municipal works	100,000	500	20	70,080
3 Small industrial works	1,000	5,000	15	52,560
4 Large industrial works	10,000	5,000	15	52,560


All other values as given in Table 1.

the TKN:COD ratio as 0.1, representative of a medium-strength sewage (Tchobanoglous *et al.* 2003), and the %

COD removal taken as 95%. This is comparable to that of food and beverage wastewater at the same feed concentration (Judd 2011, 2014).

Operation and maintenance

For an immersed MBR the key operating parameters are the flux and membrane air scour, the latter quantified as the specific aeration demand with respect to the membrane area (SAD_m) in Nm³ · h⁻¹ per m² membrane area. Whereas SAD_m does not in principle change with feedwater type, and has been reported to be $\sim 0.30 \pm 0.11 \text{ Nm}^3 \cdot \text{h}^{-1} \cdot \text{m}^2$ for an

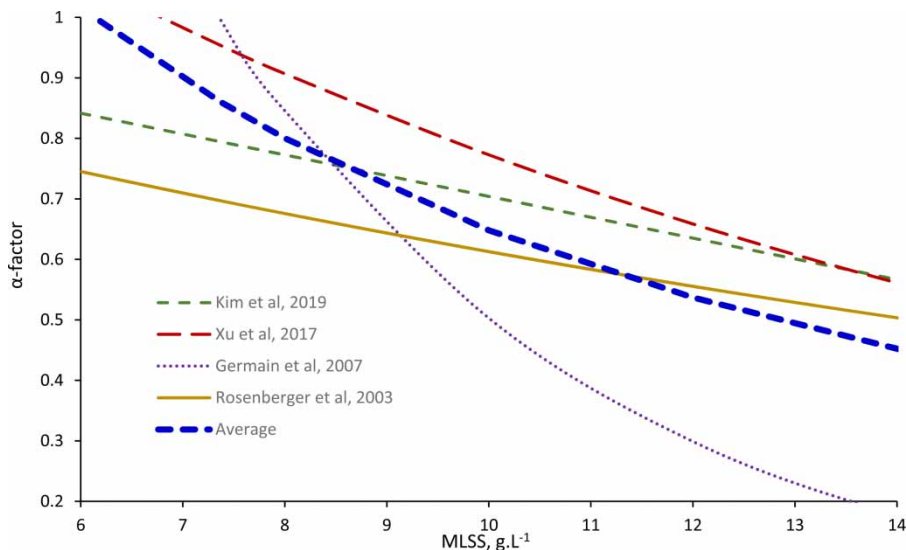**Figure 1** | Published alpha factor trends.

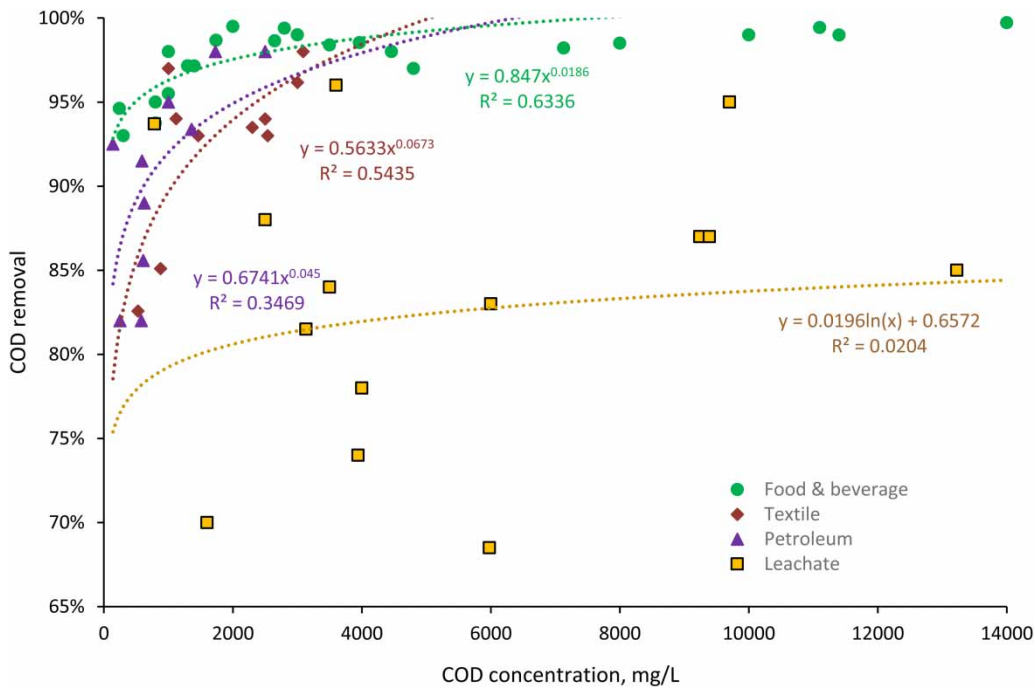


Figure 2 | COD removal as a function of feedwater concentration for four different industrial effluent types (see Supplementary Material for data sources).

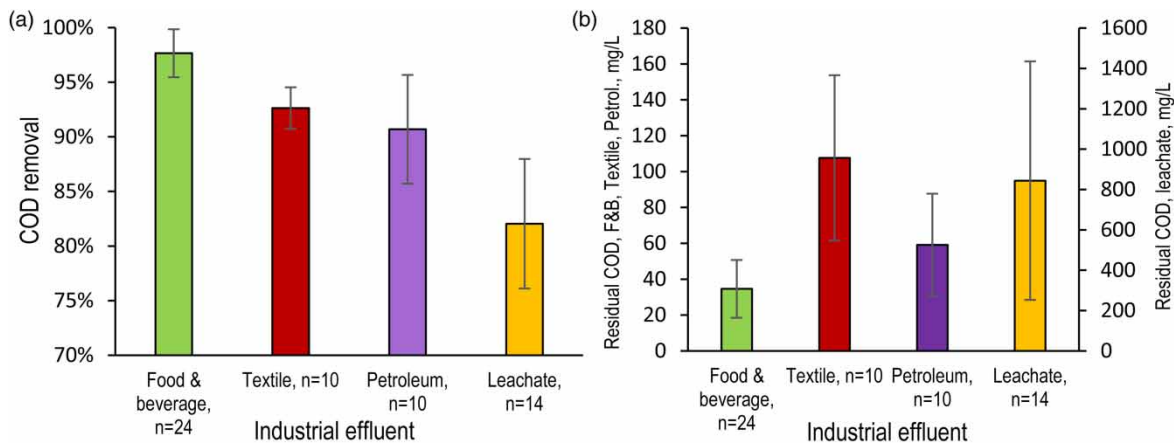


Figure 3 | Averaged data for (a) COD removal and (b) permeate COD levels for the four effluent types. Data for the textile and petroleum effluents refer to COD feed concentrations below 3,100 mg/L.

immersed hollow fibre (HF) MBR (Judd 2011), the flux is usually significantly lower for most industrial effluents compared with municipal ones (Figure 5). The current analysis assumed values of 15 and 20 LMH for the industrial and municipal effluents, respectively, based on the mean values across data sets of $n = 12$ and 24, respectively, taken from published studies. The flux does not apparently change with immersed membrane configuration, i.e. between flat sheet and hollow fibre, according to Judd (2011). The impact of both flux and air scour are considered as part of the sensitivity analysis.

Labour costs

Based on the 20 data points from the three different sources, the FTE per unit flow follows an approximate power law relationship with flow (Figure 6):

$$FTE \text{ per } 1000 \text{ m}^3 \text{ d}^{-1} = 59.3Q^{-0.507} \quad (2)$$

According to this data set, the labour effort ranges from $>3 \text{ FTE} \cdot \text{m}^{-3}$ at low flows to <0.2 at flows above $100,000 \text{ m}^3 \cdot \text{d}^{-1}$. An operator rate of \$25 per FTE-h, or

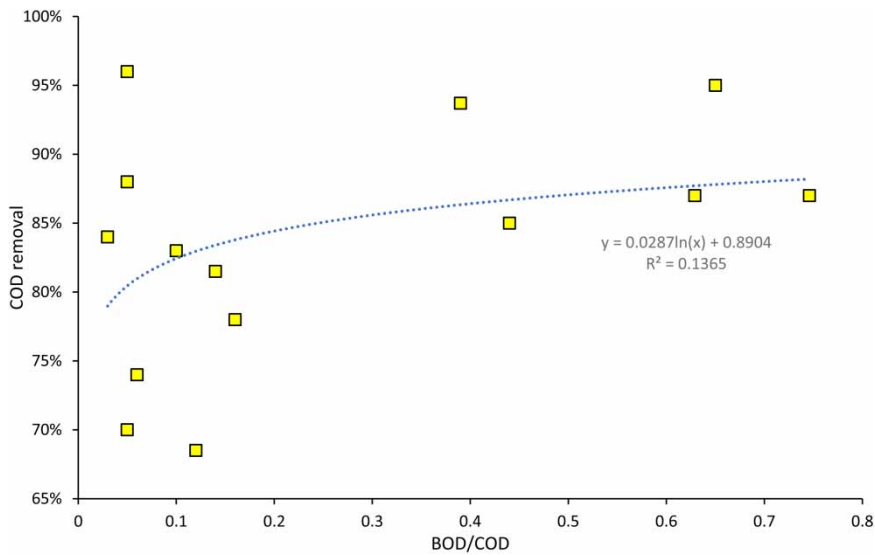


Figure 4 | COD removal as a function of feedwater BOD/COD ratio, landfill leachate data.

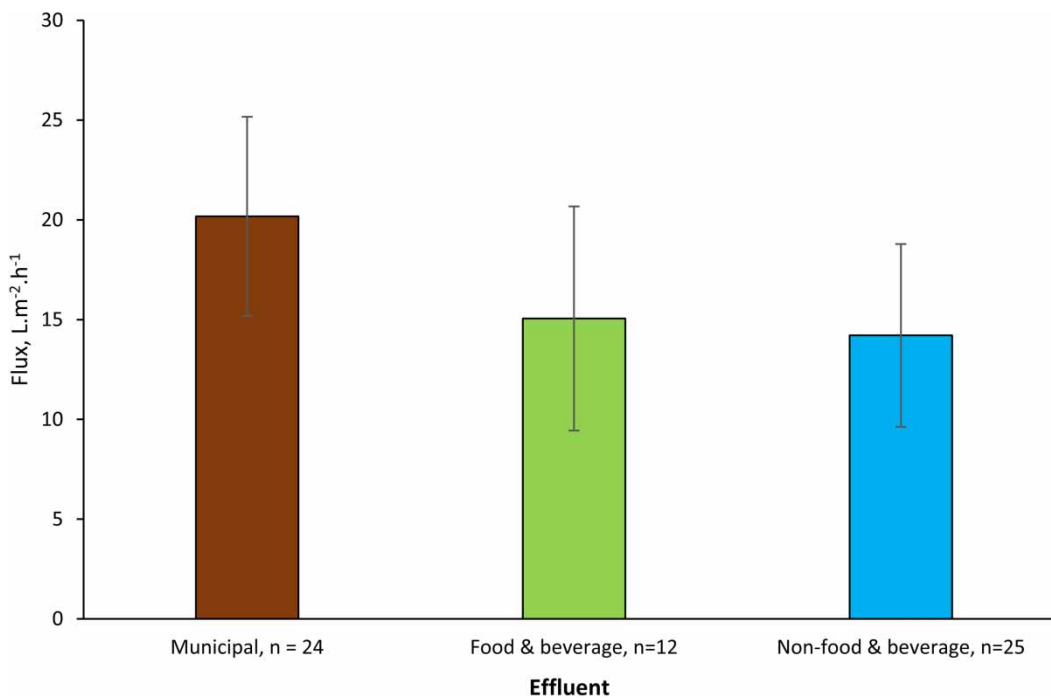


Figure 5 | Mean net flux values reported for municipal and industrial MBRS.

\$200 FTE-d⁻¹, including overheads, was assumed in the current analysis.

Computed OPEX trends

The distribution of OPEX between the five cost contributors indicates the labour costs to be the most consistently significant factor for all the scenarios considered, other than for

the large municipal plant of Scenario 2 (Figure 7). At the very large flow (100,000 m³/d) considered for this case, the labour costs are around 25% lower than the energy cost. For the benchmark case of a medium-sized municipal works (Scenario 1, 10,000 m³/d capacity), labour costs contribute 50% of the total OPEX (Figure 7). At the low flows of the small industrial effluent plant the labour costs represent 61% of the total.

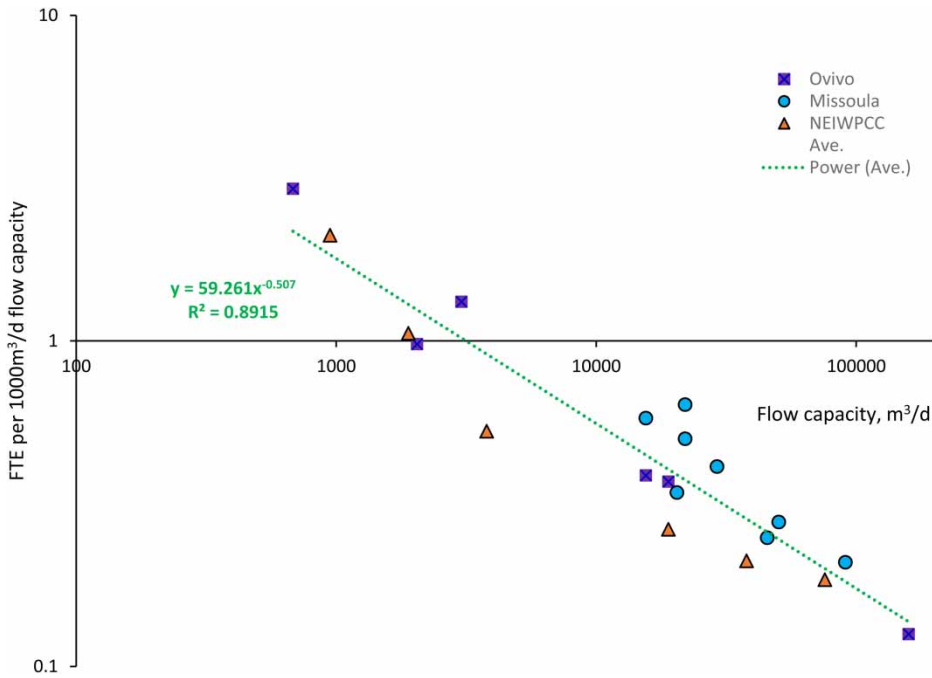


Figure 6 | Labour effort as FTE per 1,000 m³/d flow vs. plant flow capacity.

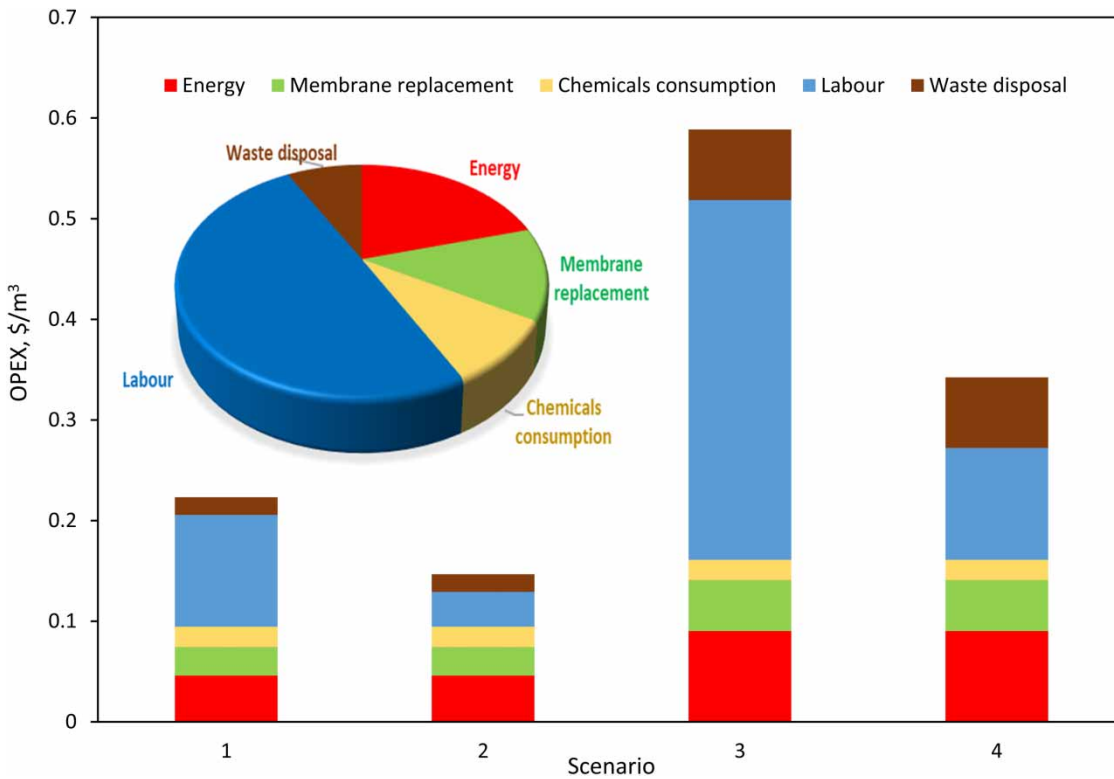


Figure 7 | OPEX contributions for the four scenarios considered (see Table 3: 1 Medium municipal works, 2 Large municipal works, 3 Small industrial works, 4 Large industrial works). Inset shows distribution for Scenario 1.

Whilst labour costs are often ignored in OPEX analysis, the few which have included it have indicated a wide

variation in its contribution to overall costs, from as little as 13% (DeCarolis *et al.* 2007) to as much as 70% (Cashman

& Mosely 2016) for a $19,000 \text{ m}^3 \cdot \text{d}^{-1}$ MLD municipal WwTW. In the exhaustive analysis conducted by Young *et al.* (2013), also for a $19,000 \text{ m}^3 \cdot \text{d}^{-1}$ capacity plant, labour costs (based on 7 FTE staff effort in their case) were calculated to contribute 44% of the OPEX. This is very close to the figure of 42% computed for the same flow capacity using the approach of the current study, where the corresponding labour effort from Equation (2) is 7.5 FTE. However, as pointed out by Young *et al.*, labour

costs vary widely regionally: the $\$25 \text{ h}^{-1}$ rate used in the current analysis would be considered low in most regions of Western Europe, the USA and Japan and high in the Philippines, Central Africa and the Indian sub-continent.

A consideration of the sensitivity of the total cost to the 12 individual parameters for each of the four scenarios indicates, as expected, the labour cost to be the most significant of the factors considered other than for the large municipal plant (Figure 8), where flux and energy cost are more significant

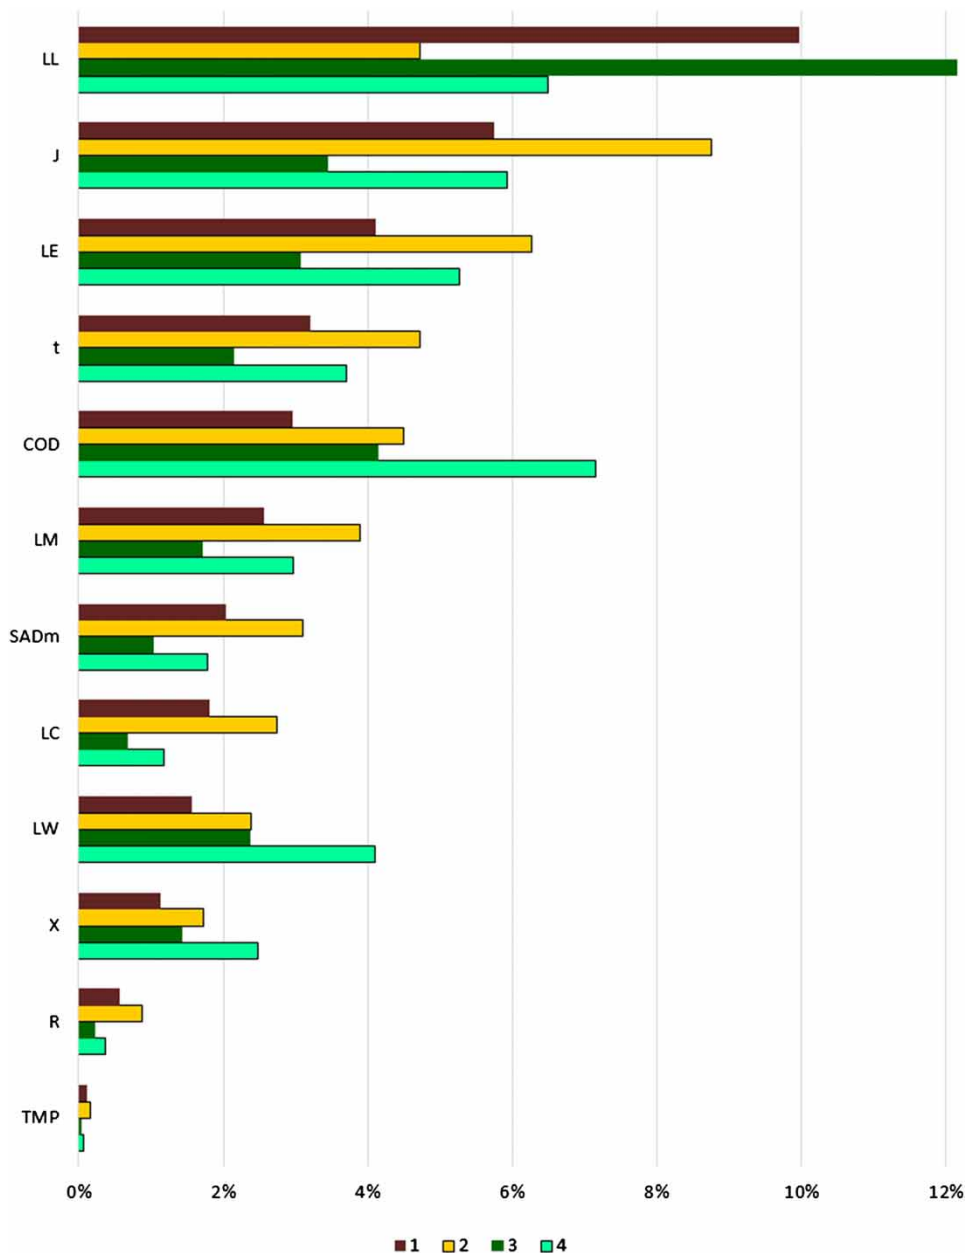


Figure 8 | % change in total OPEX across Scenarios 1–4 for a 20% change in labour cost (L_L), flux (J), electrical energy cost (L_E), membrane life (t), feed COD, membrane cost (L_M), specific aeration demand (SAD_m), chemicals cost (L_C), waste disposal cost (L_W), MLSS concentration (X), recirculation ratio (R), and transmembrane pressure (TMP). Scenarios considered as given in Table 3.

factors, and large industrial plant where the COD concentration is more significant. COD concentration impacts on both the biological energy demand and waste sludge generation, the impact being proportionally larger for larger plants where the flow-normalised labour costs are lower.

Following labour costs, the most consistently significant factor across all scenarios considered is the flux. Flux (J) takes an inverse relationship with both the air:permeate ratio ($SAD_p = SAD_m/J$) and the membrane replacement frequency ($f_m = L_M/(J t)$), and so has a greater impact than either membrane life (t) or specific aeration demand (SAD_m) alone. Nonetheless, for small- to medium-sized plants, its impact is less significant than that of labour effort.

The analysis provides a graphic demonstration of the widely-recognised trade-off between OPEX and CAPEX. The most direct way of reducing labour costs is by reducing the staff effort. Ignoring discounting and inflation – or else assuming the two to be approximately equal – a halving of the mean staff effort for a 1,000 m³/d plant would save around \$0.8–0.9 m over a 20-year plant life based on the assumptions used in the current study. This is in the region of 12–20% of the CAPEX for a typical municipal iMBR plant CAPEX (Young *et al.* 2013; Cashman & Mosely 2016).

It should finally be acknowledged that MBR technology is expected to achieve the ultimate treatment goal with respect to treated water quality, allowing discharge or possibly reuse of the treated effluent. Whilst this appears attainable for municipal and food & beverage effluents, as well as the petroleum and textile effluents featured in this analysis, landfill leachate is much more variegated in terms of its treatability. Downstream polishing of the MBR permeate would be required in many cases for this effluent type, adding to the OPEX.

CONCLUSIONS

The treatability of four different industrial effluent types (food and beverage, textile, petroleum and landfill leachate) by a membrane bioreactor (MBR) has been assessed with reference to the %COD removal vs. the feedwater COD concentration. The operating expenditure (OPEX) associated with the treatment of a food and beverage industrial effluent has subsequently been computed and compared with that of municipal wastewater treatment. Both the treatability and OPEX trends generated were based on published data.

Results for the three generic wastewater types indicated %COD removal to follow a roughly logarithmic trend with COD concentration up to a threshold of around 4,000 mg/L

COD, albeit with significant data scatter ($R^2 = 0.36$ – 0.54), for three of the four effluent types. Above a threshold feed COD of around 4,000 mg/L the COD removal was 97–98% for these effluents (food and beverage, petroleum and textile). For the landfill leachate the data were highly scattered and overall removal much lower, resulting in permeate COD levels more than 20 times those associated with food and beverage treatment over the same feed COD concentration range.

The OPEX determination revealed labour costs to contribute more significantly than any other of the 12 parameters computed for three of the four scenarios considered (small and large industrial effluent treatment plant and the medium-sized municipal wastewater works), the exception being large municipal works where flux had the greatest impact. An outline full cost analysis suggested that a halving of the mean staff effort for a 1,000 m³/d plant would save around \$0.8–0.9 m over a 20-year plant life, equating to 12–20% of the plant investment costs. This outcome suggests that it is likely to be cost effective to invest in items such as automated process control and pretreatment – the latter being widely identified by practitioners as being the pinch point in MBR design – to reduce labour effort over the plant life.

ACKNOWLEDGEMENTS

This work was made possible by the support of a National Priorities Research Programme (NPRP) grant from the Qatar National Research Fund (QNRF), grant reference number NPRP8-1115-2-473. The statements made herein are solely the responsibility of the authors.

REFERENCES

- Alvarez-Vazquez, H., Jefferson, B. & Judd, S. J. 2004 Membrane bioreactors vs conventional biological treatment of landfill leachate: A brief review 2004. *J. Chem. Technol. Biotech.* **79** (10), 1043–1049.
- Bertanza, G., Canato, M., Laera, G. & Tomei, M. C. 2015 Methodology for technical and economic assessment of advanced routes for sludge processing and disposal. *Env. Sci. Pollution Res.* **22** (10), 7190–7202.
- Brepols, B., Schäfer, H. & Engelhardt, N. 2010 Considerations on the design and financial feasibility of full-scale membrane bioreactors for municipal applications. *Water Sci. Technol.* **61** (10), 2461–2468.
- Cashman, S. & Mosely, J. 2016 Life cycle assessment and cost analysis of water and wastewater treatment options for sustainability: influence of scale on membrane bioreactor systems, EPA/600/R-16/243, December 2016.

- Cormier, N. G. & Murphy, S. 2013 *Missoula Wastewater Treatment Staffing Assessment*. February 2013. Report by the Missoula Wastewater Treatment Facility (WWTF) and Morrison Maierle Inc., Helena, MO, USA.
- Côté, P., Alam, Z. & Penny, J. 2012 *Hollow fiber membrane life in membrane bioreactors (MBR)*. *Desalination* **288**, 145–151.
- DeCarolís, J., Adham, S., Pearce, W. R., Hirani, Z., Lacy, S. & Stephenson, R. 2007 Cost trends of MBR systems for municipal wastewater treatment. In: *Proc. Water Env. Fed.*, 13–17 October, San Diego, CA, USA, pp. 3407–3418.
- Díaz, O., González, E., Vera, L., Macías-Hernández, J. J. & Rodríguez-Sevilla, J. 2017 *Fouling analysis and mitigation in a tertiary MBR operated under restricted aeration*. *J. Memb. Sci.* **525**, 368–377.
- Germain, E., Nelles, F., Drews, A., Pearce, P., Kraume, M., Reid, E., Judd, S. J. & Stephenson, T. 2007 *Biomass effects on oxygen transfer in membrane bioreactors*. *Water Res.* **41** (5), 1038–1044.
- González, E., Díaz, O., Vera, L., Rodríguez-Gómez, L. E. & Rodríguez-Sevilla, J. 2018 *Feedback control system for filtration optimisation based on a simple fouling model dynamically applied to membrane bioreactors*. *J. Memb. Sci.* **552**, 243–252.
- Hashisho, J. & El-Fadel, M. 2016 *Membrane bioreactor technology for leachate treatment at solid waste landfills*. *Rev. Environ. Sci. Biotechnol.* **15**, 441–465.
- Henkel, J., Lemac, M., Wagner, M. & Cornel, P. 2011 *Oxygen transfer in membrane bioreactors treating synthetic greywater*. *Water Res.* **43** (6), 1711–1719.
- Iglesias, R., Simón, P., Moragas, L., Arce, A. & Rodríguez-Roda, I. 2017 *Cost comparison of full-scale water reclamation technologies with an emphasis on membrane bioreactors*. *Water Sci. Technol.* **75** (11), 2562–2570.
- Jegatheesan, V., Pramanik, B. K., Chen, J., Navaratna, D., Chang, C. Y. & Li, S. 2016 *Treatment of textile wastewater with membrane bioreactor: A critical review*. *Biores. Technol.* **204**, 202–212.
- Judd, S. 2011 *The MBR Book Principles and Applications of Membrane Bioreactors in Water and Wastewater Treatment*, 1st edn. Elsevier, London, UK.
- Judd, S. 2014 *Industrial MBRs*, 1st edn. Judd Ltd, Cranfield, UK.
- Judd, S. J. 2017 *Membrane technology costs and me*. *Water Res.* **122**, 1–9.
- Kim, S. Y., Garcia, H. A., Lopez-Vazquez, C. M., Milligan, C., Livingston, D., Herrera, A., Matosic, M., Curko, J. & Brdjanovic, D. 2019 *Limitations imposed by conventional fine bubble diffusers on the design of a high-loaded membrane bioreactor (HL-MBR)*. *Env. Sci. Pollution Res.* (in press).
- Krzeminski, P., Leverette, L., Malamis, S. & Katsou, E. 2017 *Membrane bioreactors – a review on recent developments in energy reduction, fouling control, novel configurations, LCA and market prospects*. *J. Memb. Sci.* **527**, 207–227.
- Larrea, A., Rambor, A. & Fabiyi, M. 2014 *Ten years of industrial and municipal membrane bioreactor (MBR) systems – lessons from the field*. *Water Sci. Technol.* **70** (2), 279–288.
- Lin, H., Gao, W., Meng, F., Liao, B., Leung, K., Zhao, L., Chen, J. & Hong, H. 2012 *Membrane bioreactors for industrial wastewater treatment: a critical review*. *Crit. Rev. Environ. Sci. Technol.* **42** (7), 677–740.
- Miyoshi, T., Nguyen, T. P., Tsumuraya, T., Tanaka, H., Morita, T., Itokawa, H. & Hashimoto, T. 2018 *Energy reduction of a submerged membrane bioreactor using a polytetrafluoroethylene (PTFE) hollow-fiber membrane*. *Frontiers Environ. Sci. Engng.* **12**, 3.
- Ovivo 2018 *MBR Central*. Available from: www.mbrcentral.com (accessed 28 June 2018).
- Poltak, R. F. 2008 *The Northeast Guide for Estimating Staffing at Publicly and Privately Owned Wastewater Treatment Plants*. November 2008. Report by the New England Interstate Water Pollution Control Commission, Lowell, MA, USA.
- Rosenberger, S. 2003 *Characterization of Activated Sludge From Membrane Bioreactors Treating Wastewater* ‘Charakterisierung von Belebtem Schlamm in Membranbelebungsreaktoren zur Abwasserreinigung’. VDI Verlag GmbH, Düsseldorf, Germany.
- Tang, M., Chen, Y. J., Yong, W. B. & Liu, J. 2018 *Operational experience of large-scale membrane bioreactors in an underground sewage treatment plant*. *Water Practice Technol.* **13** (3), 481–486.
- Tchobanoglous, G., Burton, F. L. & Stensel, H. D. 2003 *Wastewater Engineering: Treatment and Reuse*, 4th edn. Metcalf Eddy Inc., McGraw-Hill, NY, USA.
- Verrecht, B., Maere, T., Nopens, I., Brepols, C. & Judd, S. 2010 *The cost of a large-scale hollow fibre MBR*. *Water Res.* **44** (18), 5274–5283.
- Wang, B., Zhang, K. & Field, R. W. 2018 *Novel aeration of a large-scale flat sheet MBR: a CFD and experimental investigation*. *AIChE Journal* **64** (7), 2721–2736.
- Xiao, K., Liang, S., Wang, X., Chen, C. & Huang, X. 2019 *Current state and challenges of full-scale membrane bioreactor applications: a critical review*. *Biores. Technol.* **271**, 473–481.
- Xu, Y., Zhu, N., Sun, J., Lian, P., Xiao, K. & Huang, X. 2017 *Evaluating oxygen mass transfer parameters for large-scale engineering application of membrane bioreactors*. *Proc. Biochem.* **60**, 13–18.
- Young, T., Smoot, S., Peeters, J. & Côté, P. 2013 *When does building an MBR make sense? How variations of local construction and operating cost parameters impact overall project economics*. *Proc. Water Env. Fed.* **8**, 6354–6365.

First received 1 July 2019; accepted in revised form 9 September 2019. Available online 17 September 2019